


**Biscuit Flats 500/230kV
Line Relocation**

**Figure A-2
Existing Land Use**

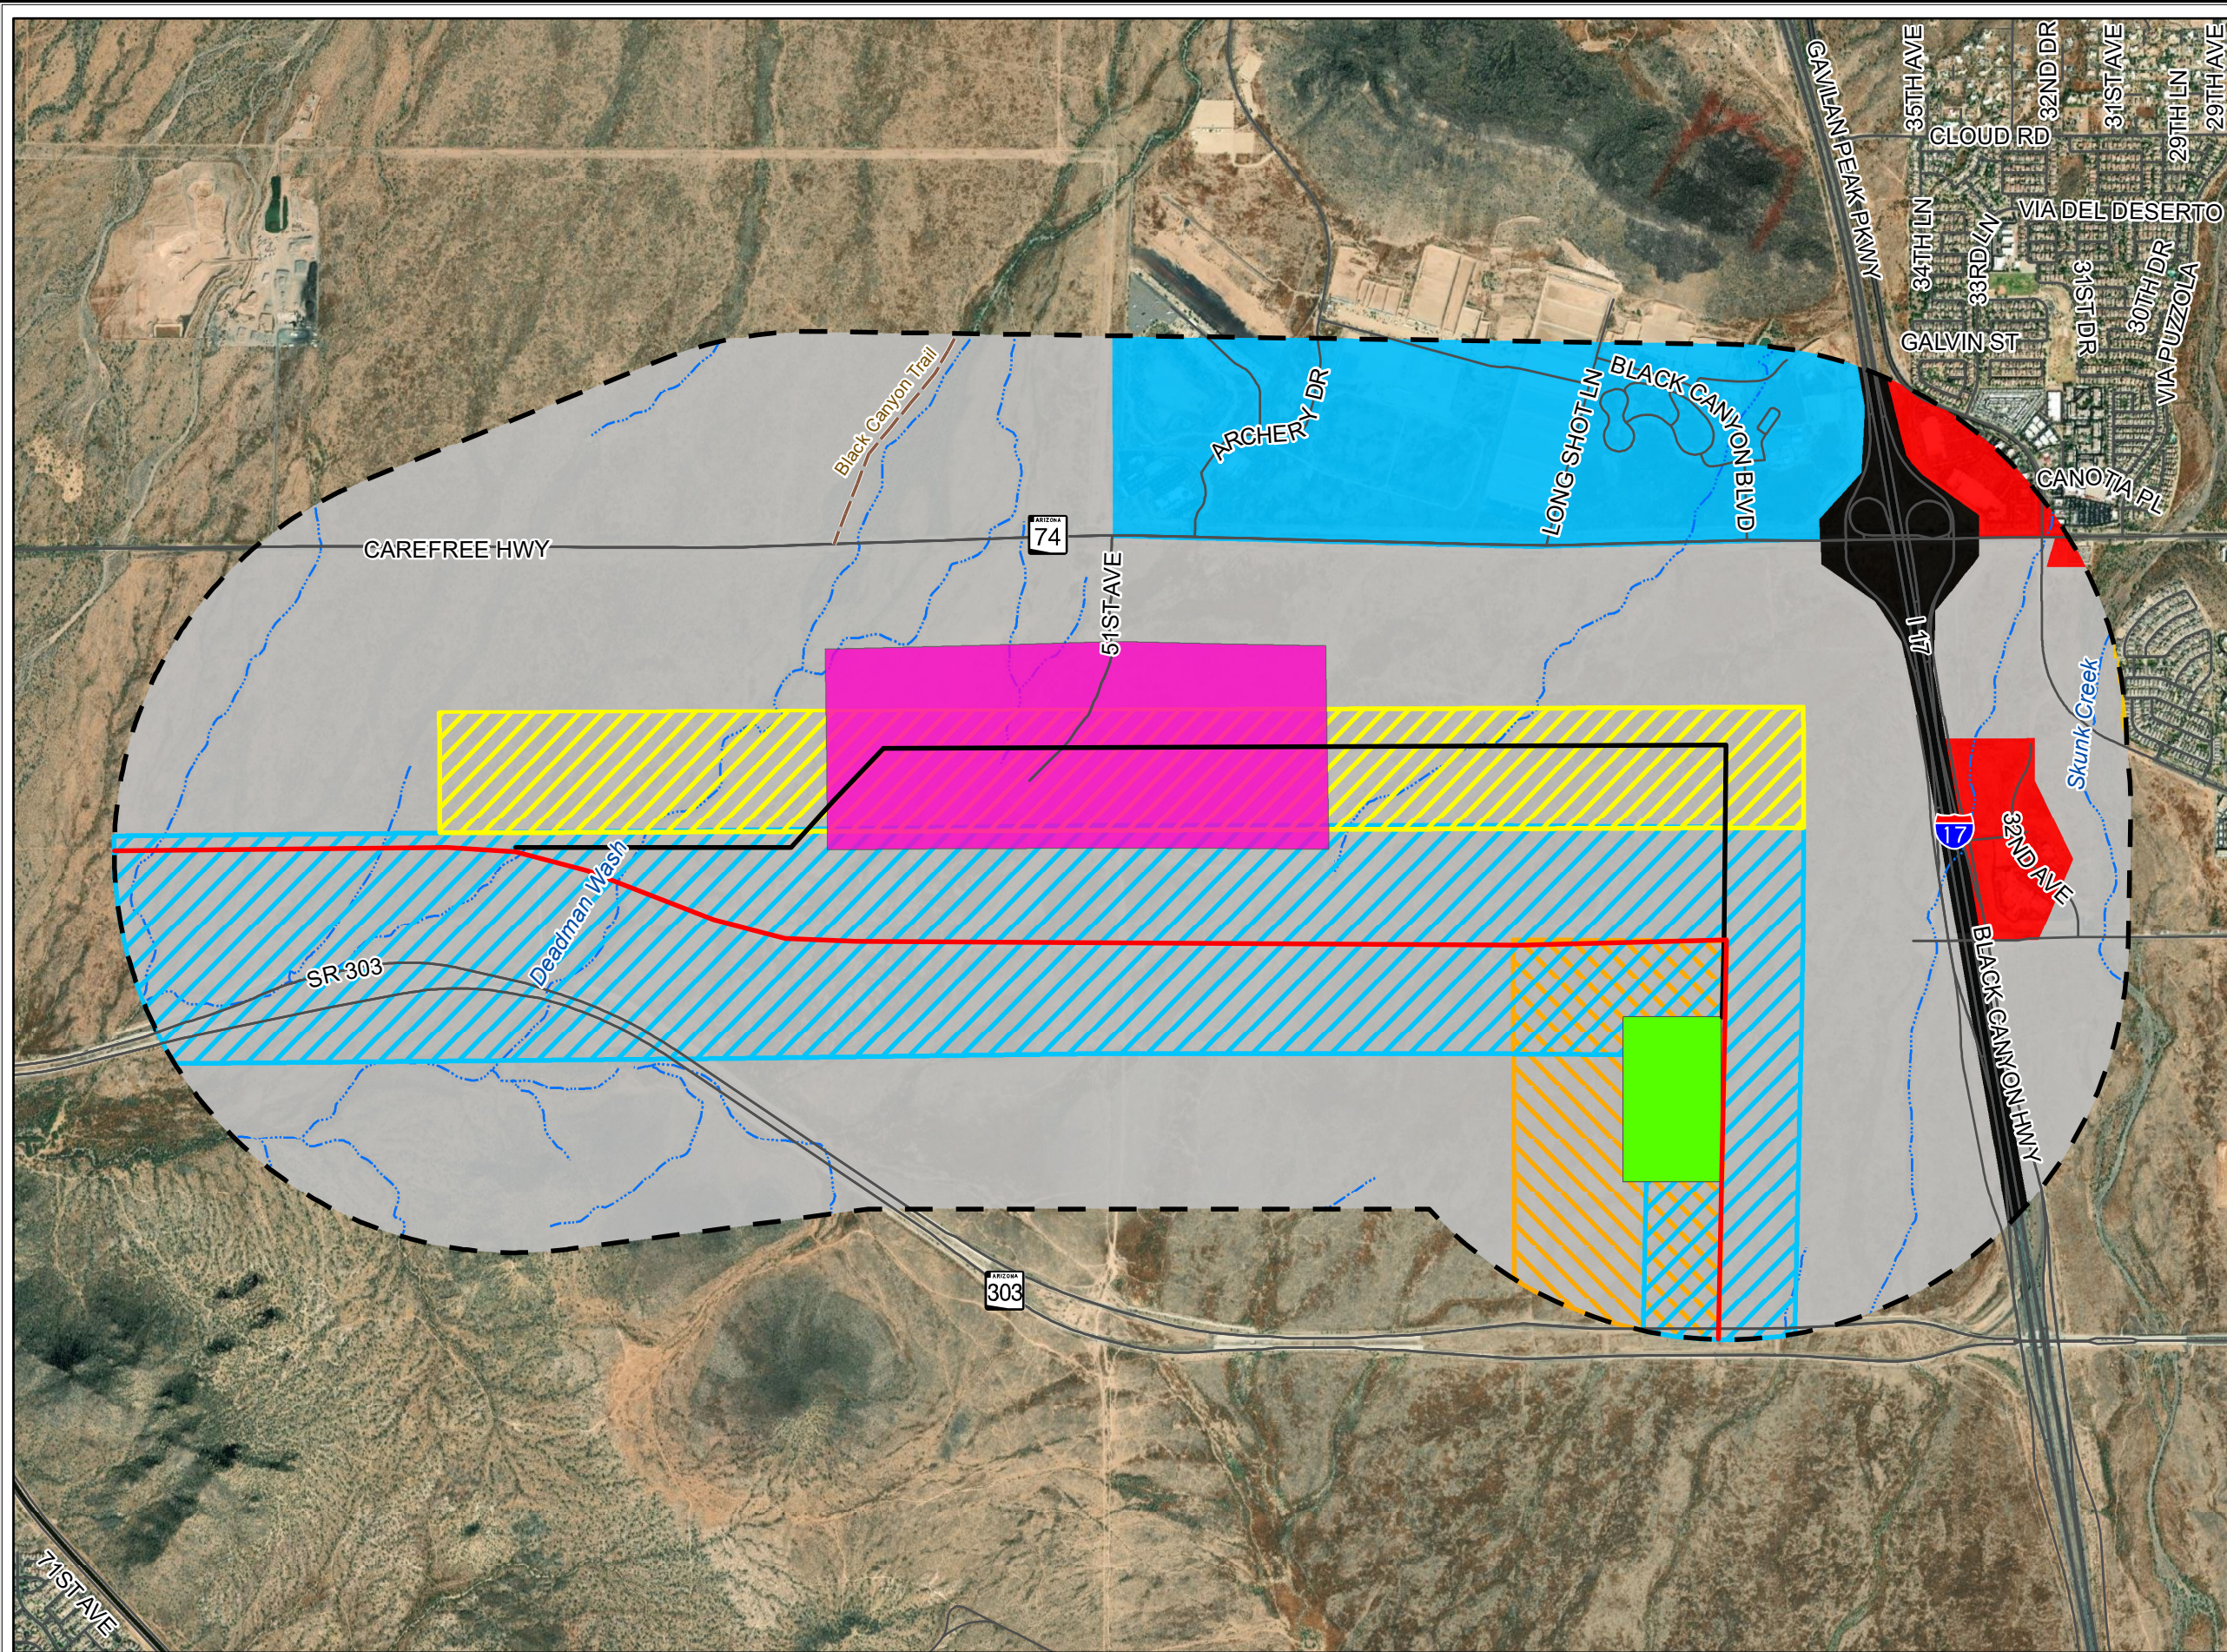

- Legend**
- Project Study Area
 - Existing 500/230kV Alignment
 - Previously Certificated Corridor
 - Proposed Corridor Expansion
 - Certificated Avery Substation Siting Area
 - Proposed Route
 - Avery Substation
 - TS22 Substation Siting Area
 - Highway/Road
 - Stream/River
- Existing Land Use**
- Commercial
 - Public / Quasi-Public
 - Residential 2 to 5 du/acre
 - Traditional Lot
 - Transportation
 - Undeveloped Land
 - Existing Trail

Source:
COP 2021, ADOT 2020, NHD 2020, ASC 2020
Imagery Source: Esri, Maxar, GeoEye, Earthstar
Geographics, CNES/Airbus DS, USDA, USGS,
AeroGRID, IGN, and the GIS User Community

