


DIMENSIONS & MINIMUM SAFETY WORKING CLEARANCES

APS CAPACITOR BANK - 12 KV

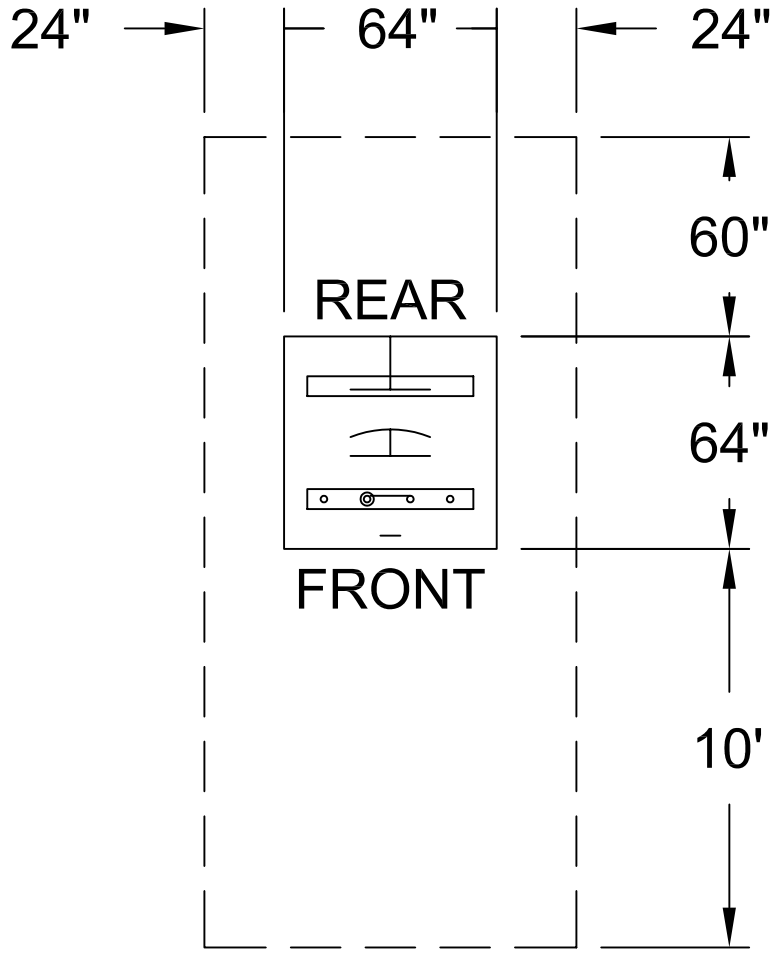

Clearance areas shall be free of obstructions such as shrubs, trees and cactus.

Final grade within the 10-foot working area shall be smooth and free of tripping hazards such as curbs and river rock.