


Voc=457VDC, Isc=7.28AMP
Vmp=376VDC, Imp=6.78AMPS

Voc=457VDC, Isc=7.28AMP
Vmp=376VDC, Imp=6.78AMPS

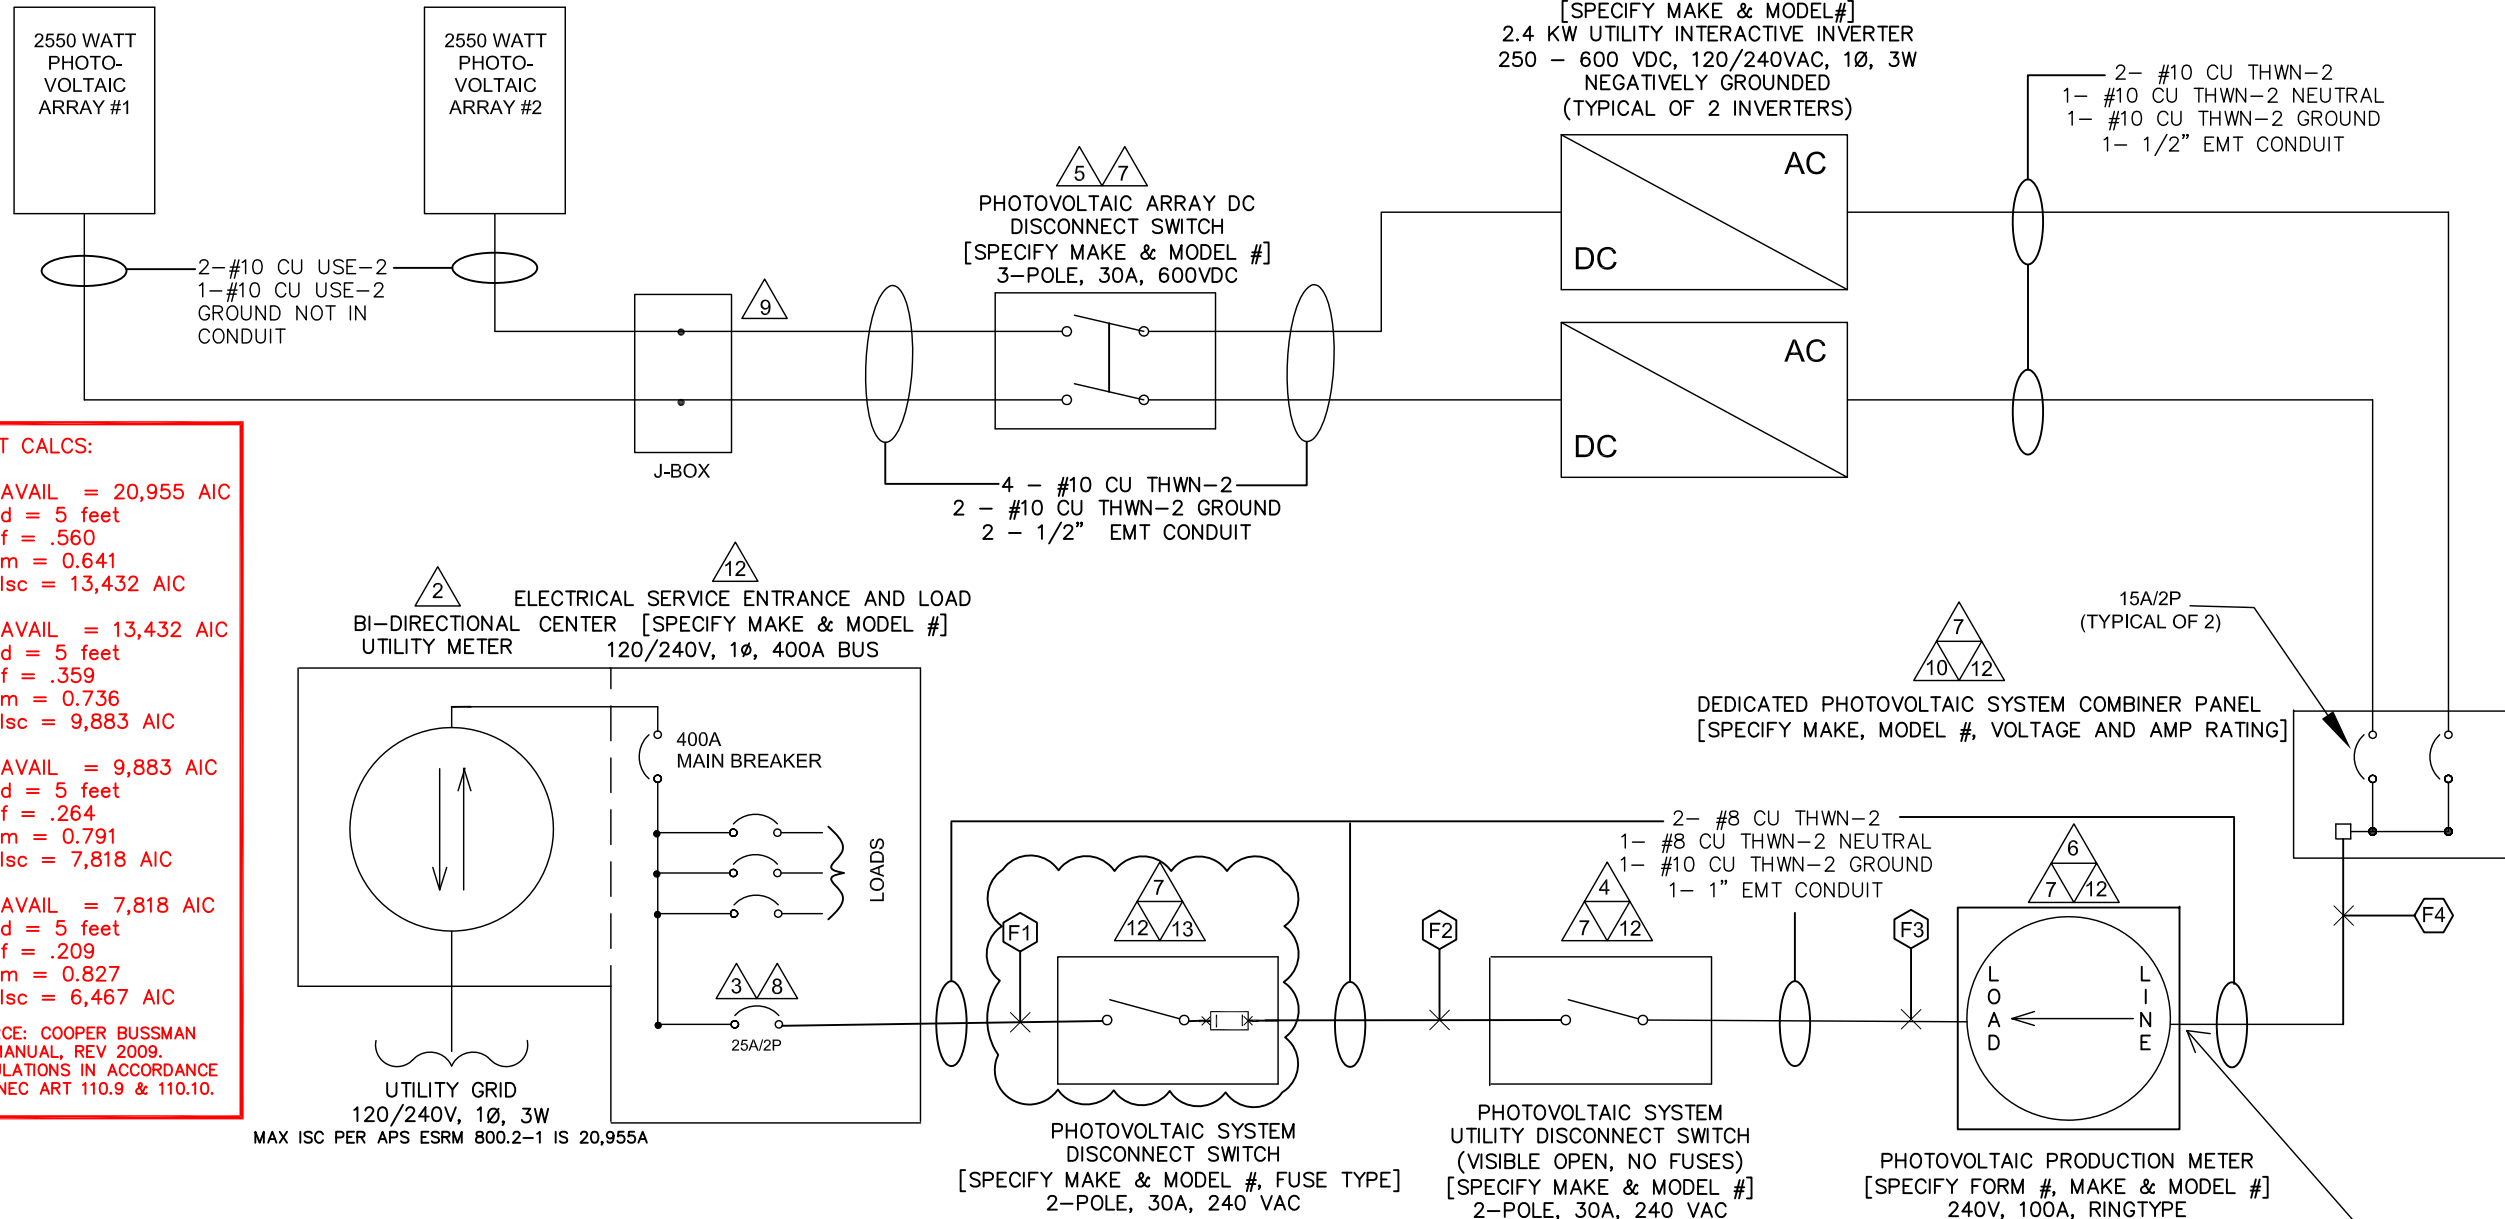

FAULT CALCS:

F1: AVAIL = 20,955 AIC
d = 5 feet
f = .560
m = 0.641
Isc = 13,432 AIC

F2: AVAIL = 13,432 AIC
d = 5 feet
f = .359
m = 0.736
Isc = 9,883 AIC

F3: AVAIL = 9,883 AIC
d = 5 feet
f = .264
m = 0.791
Isc = 7,818 AIC

F4: AVAIL = 7,818 AIC
d = 5 feet
f = .209
m = 0.827
Isc = 6,467 AIC

*SOURCE: COOPER BUSSMAN
SPD MANUAL, REV 2009.
CALCULATIONS IN ACCORDANCE
WITH NEC ART 110.9 & 110.10.

NOTES:

- 1 EQUIPMENT SHALL BE INSTALLED AND LABELED IN ACCORDANCE WITH THE NEC AND ALL APPLICABLE REQUIREMENTS OF THE SERVING ELECTRIC UTILITY COMPANY AND OF THE LOCAL AUTHORITY HAVING JURISDICTION.
- 2 BI-DIRECTIONAL UTILITY METER INSTALLED BY UTILITY COMPANY.
- 3 LABEL BREAKER "PHOTOVOLTAIC ELECTRIC POWER SOURCE" PER NEC 705.12(B)(3), AND "BREAKERS ARE BACKFED" PER NEC 705.12(B)(4). LABEL WITH THE MAXIMUM AC OUTPUT OPERATING CURRENT AND THE OPERATING VOLTAGE PER NEC 690.54.
- 4 LABEL "PHOTOVOLTAIC SYSTEM UTILITY DISCONNECT SWITCH." SWITCH COVER TO BE LOCKED AT ALL TIMES. SWITCH TO BE VISUAL OPEN AND ACCESSIBLE PER UTILITY REQUIREMENTS AND CONFORM TO NEC 705.22.
- 5 LABEL "PHOTOVOLTAIC ARRAY DC DISCONNECT DEVICE PER NEC 690.13(B). LABEL WITH MAXIMUM VOLTAGE, MAXIMUM CIRCUIT CURRENT AND MAXIMUM RATED OUTPUT CURRENT PER NEC 690.53. SWITCH TO BE LOCKED. [SHOW SWITCH INTERNAL WIRING CONFIGURATION PER MANUFACTURER'S REQUIREMENTS.]
- 6 LABEL "PHOTOVOLTAIC PRODUCTION METER." METER ENCLOSURE AND SOCKET PROVIDED AND INSTALLED BY CUSTOMER PER APS ESRM. METER PROVIDED BY CUSTOMER (AS REQUIRED).
- 7 PROVIDE WARNING SIGN PER NEC 690.13(B) READING "WARNING-ELECTRIC SHOCK HAZARD-DO NOT TOUCH TERMINALS-TERMINALS ON BOTH LINE AND LOAD SIDES MAY BE ENERGIZED IN THE OPEN POSITION."
- 8 LABEL "WARNING INVERTER OUTPUT CONNECTION. DO NOT RELOCATE THIS OVERCURRENT DEVICE" AND LOCATE BREAKER AT OPPOSITE END OF BUS FROM MAIN BREAKER LOCATION PER NEC 705.12(B)(2)(3)(b).
- 9 METALLIC CONDUIT SHALL BE USED WITHIN BUILDING PER NEC 690.31(E)
- 10 LABEL "DEDICATED PHOTOVOLTAIC SYSTEM COMBINER PANEL" AND "DO NOT ADD LOADS TO THIS PANEL."
- 11 GEC TO BE INSTALLED AS REQUIRED BY MANUFACTURER INSTRUCTIONS AND NEC 690.47.
- 12 EQUIPMENT SHALL BE LISTED, TESTED AND MARKED TO WITHSTAND THE AVAILABLE SHORT CIRCUIT CURRENT.
- 13 INSTALL AS REQUIRED TO ENSURE PHOTOVOLTAIC SYSTEM UTILITY DISCONNECT SWITCH AND PRODUCTION METER AFC RATINGS ARE NOT EXCEEDED. LABEL "PHOTOVOLTAIC SYSTEM DISCONNECT SWITCH". SWITCH COVER TO BE LOCKED BY CUSTOMER AT ALL TIMES, AND COMPLY WITH NEC 705.22.

**NOTE: SYSTEM DESIGNED
IN ACCORDANCE WITH THE
2017 N.E.C.**

This Sample Drawing is for illustration purposes only and is not to be used for design or construction. This drawing and its suitability for end use is not implied. The intent is to only illustrate typical minimum information required at time of application to APS. Additional information may be required.

SAMPLE LOAD SIDE CONNECTION ONE - LINE DIAGRAM

1234 South Main Street Any City, Arizona 85123 Tel: 602-555-5555		ABC SOLAR COMPANY, INC.	
APPROVALS		DATE	
DRAWN ABC		1-26-17	
CHECKED			
ENGINEER			
REV.			
ABC PROJECT #1111-9999		SIZE B	DRAWING NO. 0000-0001
SCALE NA		REV.	SHEET 1 OF 5


PV ARRAY #1
550 WATT PHOTOVOLTAIC ARRAY
SEE DWG# 0000-0003 FOR
WIRING DETAIL

PV ARRAY #2
2550 WATT PHOTOVOLTAIC ARRAY
SEE DWG# 0000-0003 FOR
WIRING DETAIL

This Sample Drawing is for illustration purposes only and is not to be used for design or construction. This drawing and its suitability for end use is not implied. The intent is to only illustrate typical minimum information required at time of application to APS. Additional information may be required.

[SPECIFY MAKE & MODEL#]
2.4 KW UTILITY INTERACTIVE INVERTER
250 - 600 VDC, 120/240VAC, 1Ø, 3W
NEGATIVELY GROUNDED
(TYPICAL OF 2 INVERTERS)

2- #10 CU THWN-2
1- #10 CU THWN-2 NEUTRAL
1- #10 CU THWN-2 GROUND
1- 1/2" EMT CONDUIT

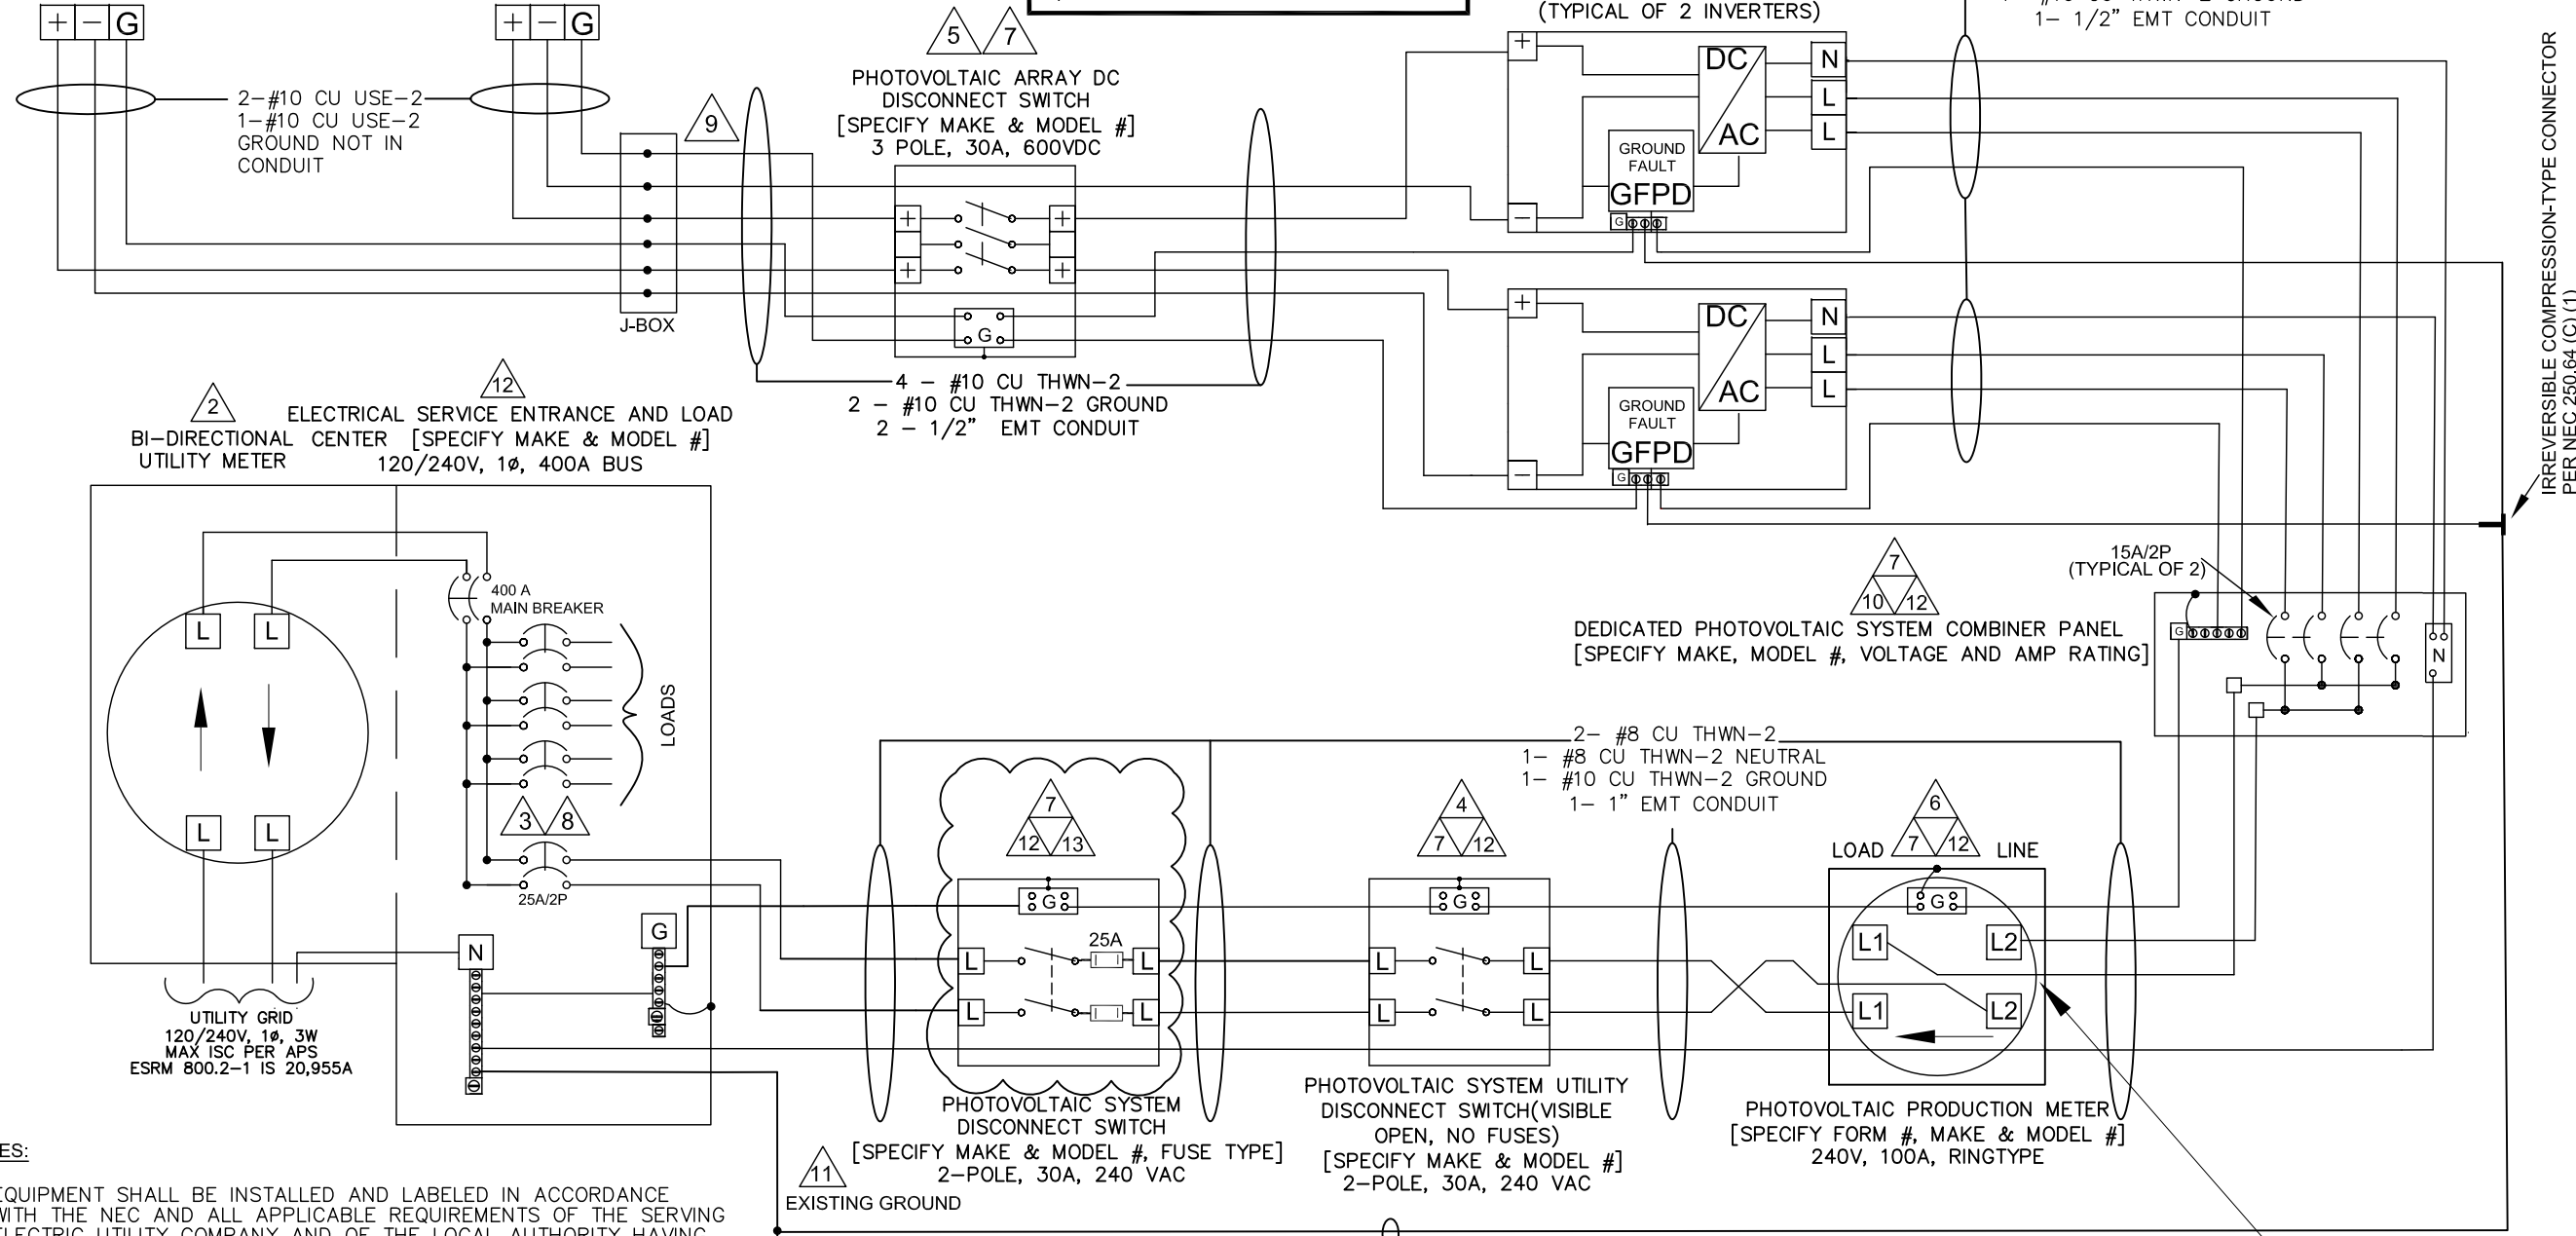

IRREVERSIBLE COMPRESSION-TYPE CONNECTOR
PER NEC 250.64 (C) (1)

NOTES:

- 1 EQUIPMENT SHALL BE INSTALLED AND LABELED IN ACCORDANCE WITH THE NEC AND ALL APPLICABLE REQUIREMENTS OF THE SERVING ELECTRIC UTILITY COMPANY AND OF THE LOCAL AUTHORITY HAVING JURISDICTION.
- 2 BI-DIRECTIONAL UTILITY METER INSTALLED BY UTILITY COMPANY.
- 3 LABEL BREAKER "PHOTOVOLTAIC ELECTRIC POWER SOURCE" PER NEC 705.12(B)(3), AND "BREAKERS ARE BACKFED" PER NEC 705.12(B)(4). LABEL WITH THE MAXIMUM AC OUTPUT OPERATING CURRENT AND THE OPERATING VOLTAGE PER NEC 690.54.
- 4 LABEL "PHOTOVOLTAIC SYSTEM UTILITY DISCONNECT SWITCH." SWITCH COVER TO BE LOCKED AT ALL TIMES. SWITCH TO BE VISUAL OPEN AND ACCESSIBLE PER UTILITY REQUIREMENTS AND CONFORM TO NEC 705.22.
- 5 LABEL "PHOTOVOLTAIC ARRAY DC DISCONNECT DEVICE PER NEC 690.13(B). LABEL WITH MAXIMUM VOLTAGE, MAXIMUM CIRCUIT CURRENT AND MAXIMUM RATED OUTPUT CURRENT PER NEC 690.53. SWITCH TO BE LOCKED. [SHOW SWITCH INTERNAL WIRING CONFIGURATION PER MANUFACTURER'S REQUIREMENTS.]
- 6 LABEL "PHOTOVOLTAIC PRODUCTION METER." METER ENCLOSURE AND SOCKET PROVIDED AND INSTALLED BY CUSTOMER PER APS ESRM. METER PROVIDED BY CUSTOMER (AS REQUIRED).
- 7 PROVIDE WARNING SIGN PER NEC 690.13(B) READING "WARNING-ELECTRIC SHOCK HAZARD-DO NOT TOUCH TERMINALS-TERMINALS ON BOTH LINE AND LOAD SIDES MAY BE ENERGIZED IN THE OPEN POSITION."
- 8 LABEL "WARNING INVERTER OUTPUT CONNECTION. DO NOT RELOCATE THIS OVERCURRENT DEVICE" AND LOCATE BREAKER AT OPPOSITE END OF BUS FROM MAIN BREAKER LOCATION PER NEC 705.12(B)(2)(3)(b).
- 9 METALLIC CONDUIT SHALL BE USED WITHIN BUILDING PER NEC 690.31(E)
- 10 LABEL "DEDICATED PHOTOVOLTAIC SYSTEM COMBINER PANEL" AND "DO NOT ADD LOADS TO THIS PANEL."
- 11 GEC TO BE INSTALLED AS REQUIRED BY MANUFACTURER INSTRUCTIONS AND NEC 690.47.
- 12 EQUIPMENT SHALL BE LISTED, TESTED AND MARKED TO WITHSTAND THE AVAILABLE SHORT CIRCUIT CURRENT.
- 13 INSTALL AS REQUIRED TO ENSURE PHOTOVOLTAIC SYSTEM UTILITY DISCONNECT SWITCH AND PRODUCTION METER AFC RATINGS ARE NOT EXCEEDED. LABEL "PHOTOVOLTAIC SYSTEM DISCONNECT SWITCH". SWITCH COVER TO BE LOCKED BY CUSTOMER AT ALL TIMES, AND COMPLY WITH NEC 705.22.

NOTE: SYSTEM DESIGNED IN ACCORDANCE WITH THE 2017 N.E.C.

SAMPLE LOAD SIDE CONNECTION THREE-LINE DIAGRAM


1234 South Main Street Any City, Arizona 85123 Tel: 602-555-5555		ABC SOLAR COMPANY, INC.	
APPROVALS		DATE	
DRAWN ABC		1-26-17	
CHECKED			
ENGINEER			
REV.			
ABC PROJECT #1111-9999		SIZE B	DRAWING NO. 0000-0002
SCALE NA		REV.	SHEET 2 OF 5

NOTE: UTILITY HAS 24-HR UNRESTRICTED ACCESS TO ALL PHOTOVOLTAIC SYSTEM COMPONENTS AND SERVICE ENTRANCE.


NOTE: REFERENCE SECTION 301.15 OF THE APS ESRM FOR ELECTRIC METER SEPARATION BETWEEN WATER AND GAS.

NOTE: WORKSPACE IN FRONT OF AC ELECTRICAL SYSTEM COMPONENTS SHALL BE IN ACCORDANCE WITH APS AND NEC REQUIREMENTS. FOR APS REQUIREMENTS, REFERENCE SECTION 300 OF THE APS ESRM AND SECTION 8.2 OF THE APS INTERCONNECTION REQUIREMENTS.

This Sample Drawing is for illustration purposes only and is not to be used for design or construction. This drawing and its suitability for end use is not implied. The intent is only to illustrate typical minimum information required at time of application to APS. Additional information may be required.

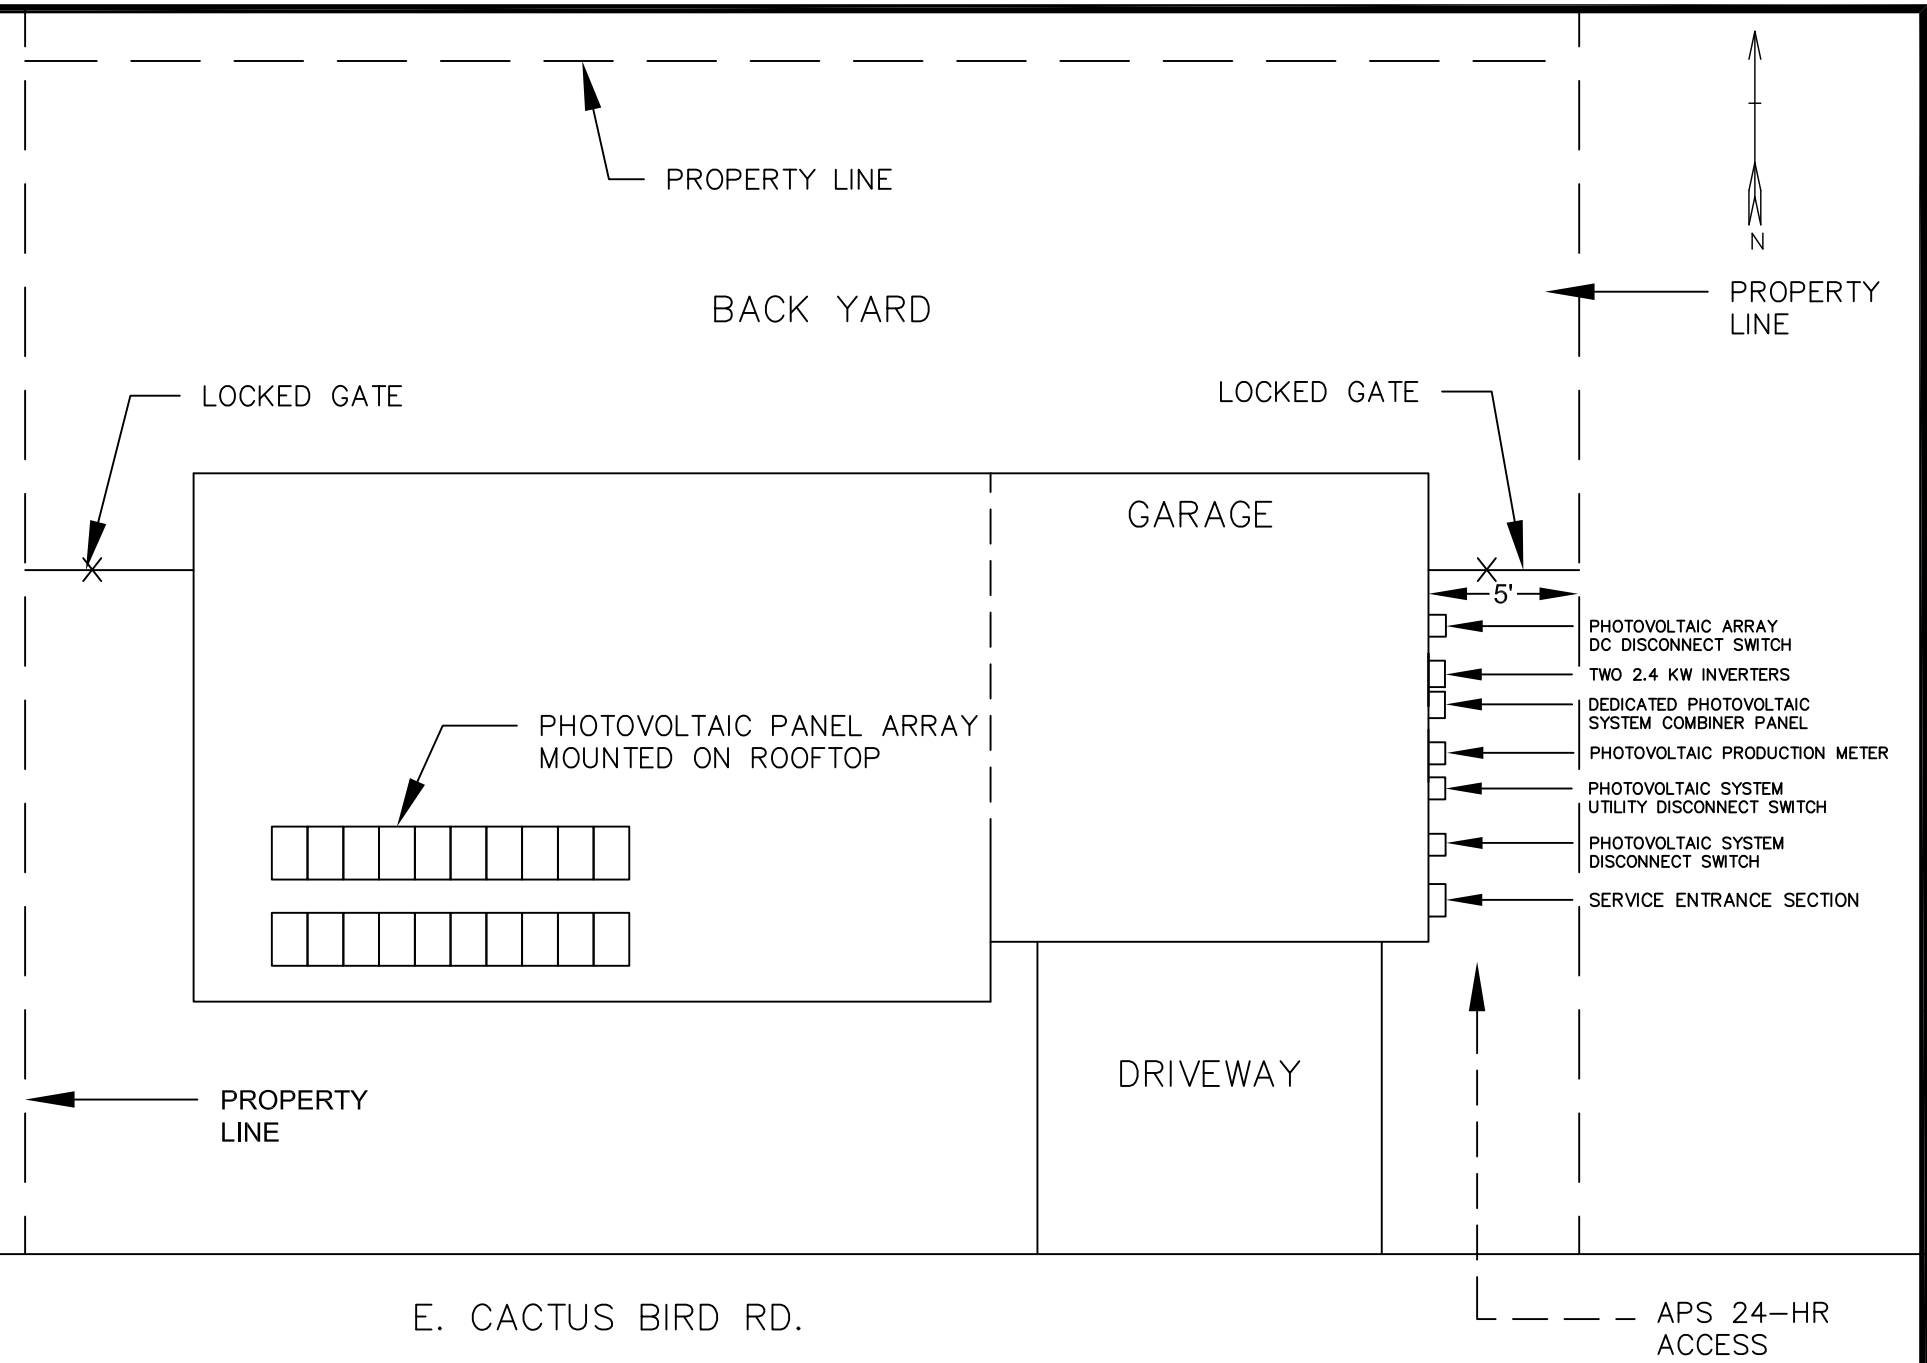

ELEVATION VIEW

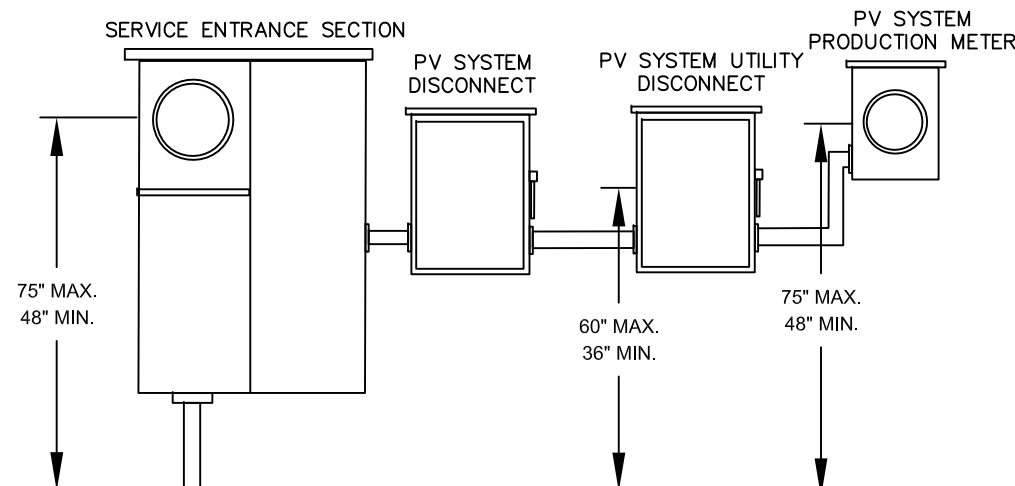

SAMPLE LOAD SIDE CONNECTION SITE PLAN

1234 South Main Street Any City, Arizona 85123 Tel: 602-555-5555		ABC SOLAR COMPANY, INC.	
APPROVALS		DATE	
DRAWN ABC		1-26-17	
CHECKED			
ENGINEER			
REV.			
ABC PROJECT #1111-9999		SIZE B	DRAWING NO. 0000-0005
SCALE NA		REV.	SHEET 5 OF 5

SITE PLAN

4.8 KW AC PHOTOVOLTAIC SYSTEM
333 E. CACTUS BIRD RD.
ANY CITY, AZ 85123