

PowerClerk Updates/Reminders


Alex Martinez
March 30, 2022



Email Volume



Email Volume

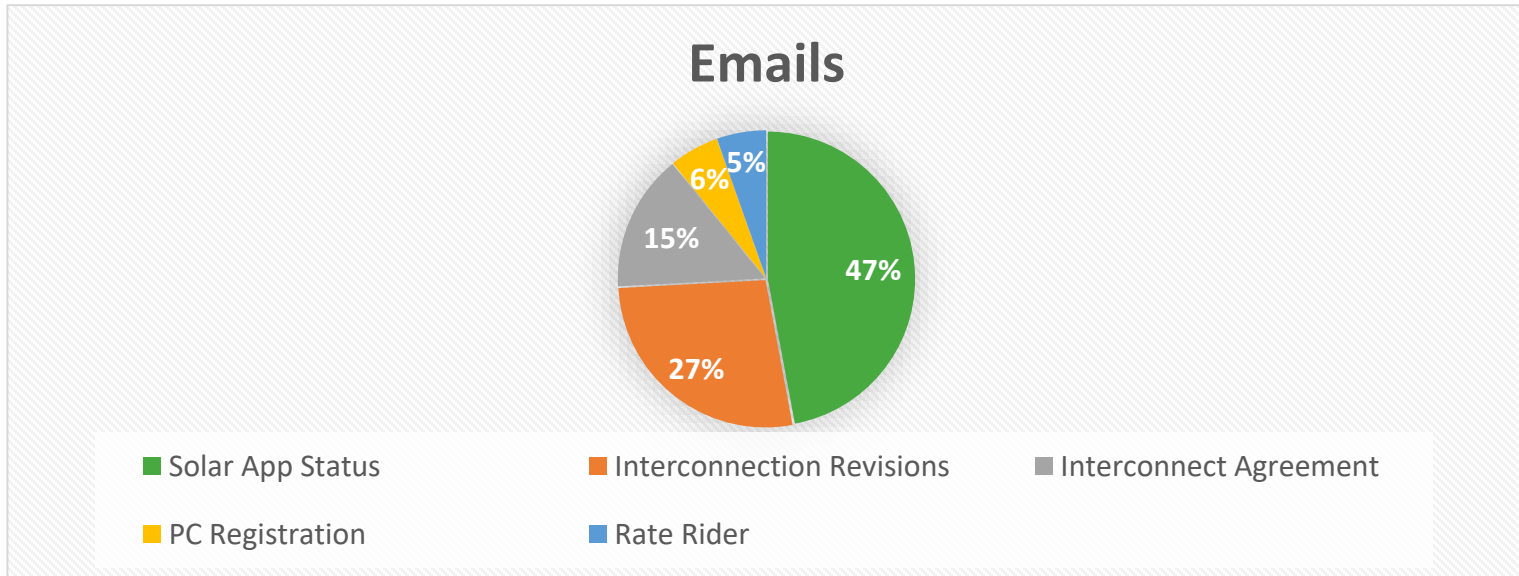

Application Updates/Corrections

- Equipment Addendum Request
 - Application updates
 - Equipment updates
 - System size change exception

Per APS Interconnection Requirements, a change in total system size is not considered a minor modification. Therefore, this application will be canceled and a new application must be submitted for review.

PowerClerk Equipment List

- Adding Equipment
 - Inverters/modules managed by Clean Power via California Energy Commission (CEC)
- Battery
 - Managed by APS
 - Send requests to Renewables@aps.com
 - Include Specification Sheet

Questions?

